

REV.	DESCRIPTION	APP'D	DATE
A	INITIAL ISSUE		
B	SERVICE ADD/ PIPE SIZE ADJUSTED	G.H.	27/03/06
C	WATER CORP AMENDMENTS	G.H.	19/06/06
0	ISSUED FOR CONSTRUCTION		
1	SERVICES TO LOT 560 AMENDED		

NOTES

- ALL WORKS SHALL BE CARRIED OUT TO THE REQUIREMENTS OF THE WATER CORPORATION, WHERE THEIR REQUIREMENTS ARE IN CONFLICT WITH WHAT IS SHOWN ON THE DRAWINGS, THE CONTRACTOR SHALL OBTAIN DIRECTION FROM THE SUPERINTENDENT PRIOR TO PROCEEDING WITH THE CONSTRUCTION.
- ANY DETAILS OF EXISTING SERVICES SHOWN ON THE DRAWINGS ARE INDICATIVE ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE TO LOCATE AND PRESERVE ALL EXISTING SERVICES.
- DETAILS OF PIPE LENGTHS AND PROPERTY SERVICE QUANTITIES ARE SHOWN ONLY FOR THE WATER CORPORATION'S INFORMATION. TENDERS SHALL FORM THEIR OWN OPINION.
- ALL PIPES SHALL BE ON A 2.1m ALIGNMENT UNLESS NOTED OTHERWISE.
- TEMP FLUSHING POINTS SHALL BE INSTALLED AT BLANK ENDS

EXTENSION

CONTRACTOR TO LAY - 1787.6m OF 100P-12
 - 1080.95m OF 150P-12
 - 196.2m OF 200P-12

CONNECTIONS


CONNECTIONS (4) TO EXISTING SHALL BE BY WATER CORPORATION AT DEVELOPERS EXPENSE.

SERVICES

NUMBER OF LOTS SERVICED - 167
 PRELAI SHORT DUAL - 44
 PRELAI SHORT SINGLE - 11
 PRELAI LONG DUAL - 28
 PRELAI LONG SINGLE - 7
 DEFERRED SERVICES - 5

LEGEND

- - - - - EXISTING MAINS.
- - - - - FUTURE MAINS
- — — — PROPOSED MAINS.
- x — PROPOSED VALVES. (17)
- ● — PROPOSED HYDRANTS. (10)
- - - - - RETICULATION BOUNDARY
- - - - - EXIST. HYDRANT & VALVE
- ● — FLUSHING POINT
- - - - - LONG SERVICES
- / — CHANGE IN PIPE SIZE/TYPE
- D DEFERRED SERVICES
- * LOTS SERVICED BUT NOT RELEASED IN THIS STAGE
- # LOTS PREVIOUSLY SERVICED RELEASED IN THIS STAGE
- ⊙ DEFLECTION BEND
- ① 11.25° BEND
- ② 22.5° BEND
- ③ 45° BEND
- ④ 90° BEND

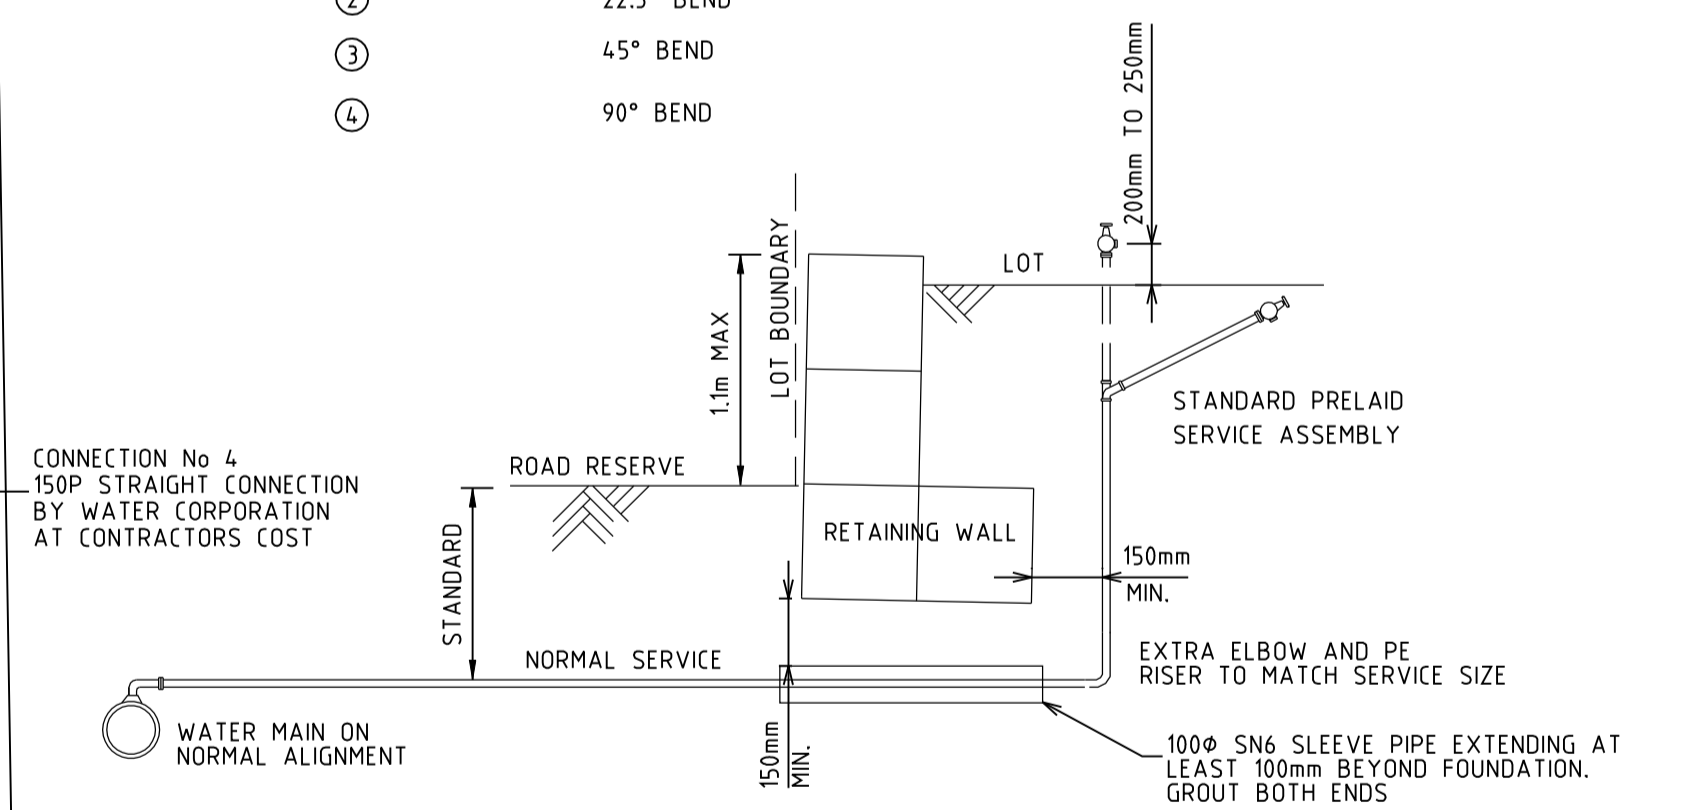

TYPICAL PRELAI SERVICE DETAIL
(FOR WALLS LESS THAN 1.1m HIGH)

- APPROVAL SUBJECT TO
- FINALISATION AND ACCEPTANCE OF THE CUSTOMER CONSTRUCTED WORKS AGREEMENT FOR THE DN375 WATER DISTRIBUTION MAIN IN LARSEN RD.
 - FINALISATION AND ACCEPTANCE OF DRAWINGS FOR THE DN375 WATER DISTRIBUTION MAIN.
 - COMPLETION OF THE REQUIREMENTS OF THE LAND DEVELOPMENT AGREEMENT TO THE CORPORATION'S SATISFACTION.
 - NO LOTS ARE TO BE RELEASED UNTIL OUTSTANDING MATTERS ARE RESOLVED AND THE DN375 WATER DISTRIBUTION MAIN HAS BEEN CONSTRUCTED TO THE CORPORATION'S SATISFACTION.

THIS PLAN IS ACCEPTED AS COMPLYING WITH OVERALL WATER SUPPLY PLANNING. COMPLIANCE WITH WATER MANUALS REMAINS THE RESPONSIBILITY OF THE CONSULTING ENGINEER

FOR MANAGER D.S BRANCH

FOR MANAGER DEVELOPMENT SERVICES




CONNECTION DETAIL 1
SCALE 1:500

CONNECTION DETAIL 2
SCALE 1:500

CONNECTION DETAIL 4
SCALE 1:500

CONNECTION DETAIL 3
SCALE 1:500

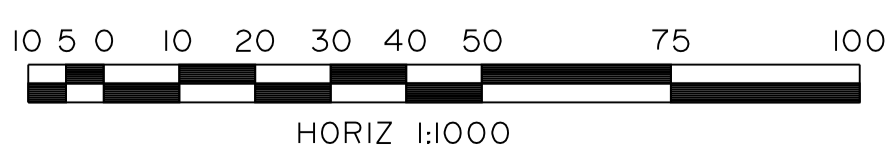

WAPC No: 126085,129226

FILE SUB: JT1 2005 07665 V01
 FILE M/E: JT1 2006 05724 V01

IK91-103-1A

Cardno GILBERT ROSE
 ABN 27 112 272 723
 CONSULTING ENGINEERS

Cardno BSO Centre
 2 Bagot Road
 P.O. Box 155 Subiaco
 Western Australia 6004
 Phone (08) 9274 3899
 Fax (08) 9388 3831

CLIENT:	BYFORD CENTRAL PTY LTD		
PROJECT:	BYFORD CENTRAL STAGE 4		
TITLE:	WATER RETICULATION PLAN		
DESIGNED: B.PATON	DRAWN: B.PATON	WAPC No: 126085,129226	SCALE: 1:1000
CHECKED: / /	DRAWING No. 2454	SHEETS 4	SIZES 400 / 1
APPROVED: / /			